# LK-S CO2 RS485 Modbus

Combined sensor CO<sub>2</sub> / temperature / rel. humidity



#### **Datasheet**

Subject to technical alteration Issue date: 24.08.2015





### **Application**

Duct air quality sensor for combined detection of CO2, relative humidity and temperature. Designed for control and monitoring applications.

## **Security Advice – Caution**



The installation and assembly of electrical equipment should only be performed by authorized personnel.

The product should only be used for the intended application. Unauthorised modifications are prohibited! The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or assets. Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Please comply with

- Local laws, health & safety regulations, technical standards and regulations
- Condition of the device at the time of installation, to ensure safe installation
- This data sheet and installation manual

#### **Notes on Disposal**



As a component of a large-scale fixed installation, Thermokon products are intended to be used permanently as part of a building or a structure at a pre-defined and dedicated location, hence the Waste Electrical and Electronic Act (WEEE) is not applicable. However, most of the products may contain valuable materials that should be recycled and not disposed of as domestic waste. Please note the relevant regulations for local disposal.

Page 2 / 5 Issue date: 24.08.2015

#### **Build-up of Self-Heating by Electrical Dissipative Power**

Temperature sensors with electronic components always have a dissipative power, which affects the temperature measurement of the ambient air. The dissipation in active temperature sensors shows a linear increase with rising operating voltage. This dissipative power has to be considered when measuring temperature. In case of a fixed operating voltage ( $\pm$ 0,2 V) this is normally done by adding or reducing a constant offset value. As Thermokon transducers work with a variable operating voltage, only one operating voltage can be taken into consideration, for reasons of production engineering. Transducers 0..10 V / 4..20 mA have a standard setting at an operating voltage of 24 V =. That means, that at this voltage, the expected measuring error of the output signal will be the least. For other operating voltages, the offset error will be increased by a changing power loss of the sensor electronics. If a re-calibration should become necessary later directly on the sensor, this can be done by means of a trimming potentiometer on the sensor board.

Remark: Occurring draft leads to a better carrying-off of dissipative power at the sensor. Thus temporally limited fluctuations might occur upon temperature measurement.

#### Application Notice for Humidity Sensors

Refrain from touching the sensitive humidity sensor/element. Touching the sensitive surface will void warranty.

For standard environmental conditions re-calibration is recommended once a year to maintain the specified accuracy.

When exposed to high ambient temperature and/or high levels of humidity or presence of aggressive gases (i.e. chlorine, ozone, ammonia) the sensor element may be affected and re-calibration may be required sooner than specified. Re-calibration and deterioration of the humidity sensor due to environmental conditions are not subject of the general warranty.

### Information about Indoor Air Quality CO<sub>2</sub>

EN 13779 defines several classes for indoor air quality:

Category	CO <sub>2</sub> content above the content in outdoor air in ppm		Description
	Typical range	Standard value	
IDA1	<400 ppm	350 ppm	Good indoor air quality
IDA2	400 600 ppm	500 ppm	Standard indoor air quality
IDA3	6001.000 ppm	800 ppm	Moderate indoor air quality
IDA4	>1.000 ppm	1.200 ppm	Poor indoor air quality

#### Information about Self-Calibration Feature CO<sub>2</sub>

All gas sensors are subject to drift caused by components. This fact results generally in the need to recalibrate the sensors regularly.

With dual channel technology Thermokon integrates automatic self-calibration for different fields of operation. In contrast to common used ABC-Logic sensors with self-calibration dual channel are suitable for applications operating 24 hours, 7 days a week as for example hospitals.

Manual calibration is not necessary!

Issue date: 24.08.2015 Page 3 / 5


### **Technical Data**

Measuring values	temperature, humidity, CO2	
Medium	air and non-aggressive gases	
Network technology	RS485 Modbus, RTU or ASCII, half-duplex, baud rate 9.600, 19.200, 38.400 or 57.600, parity: non (2 stopbits), even or odd (1 stopbit)	
Power supply	1524 V = (±10%) or 24 V ~ (±10%)	
Power consumption	max. 3 W (24 V =   6 VA (24 V ~)	
Measuring range temp	0+50 °C	
Measuring range humidity	0100% rH	
Measuring range CO2	02000 ppm	
Accuracy temperature	±1% of measuring range (typ. at 21 °C)	
Accuracy humidity	±2% between 1090% rH (typ. at 21 °C)	
Accuracy CO2	±75 ppm or ±10% of measured value (typ. at 21 °C)	
Air speed	min. 0,3 m/s, max. 10 m/s	
Calibration	self-calibration Dual Channel	
Sensor	NDIR (non-dispersiv, infrared)	
Enclosure	PA6, pure white	
Protection	IP65 according to EN 60529	
Cable entry	M20 for wire max. Ø=6 mm	
Connection electrical	terminal block, max. 1,5 mm <sup>2</sup>	
Pipe	PA6, black, Ø=19,5 mm, length 180 mm	
Filter	stainless steel wire mesh	
Ambient condition	0+50 °C, max. 85% rH short term condensation	
Weight	450 g	
Delivery content	MF20 TPO mounting flange	
Notes	enclosure with connection wire (L=1,5 m)	

## **Mounting advices**


The devices are supplied in a ready to use condition and are already equipped with a 1,5 m connection cable. Thus, there is no need to open the device. If an opening of the cover becomes necessary, however, please make sure that the housing will be hermetically-sealed, again.


The installation in a ventilation duct is made by means of the mounting flange included (fixing screws are not included).



Page 4 / 5 Issue date: 24.08.2015

#### Connection plan

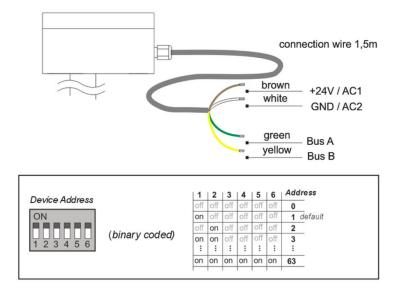



2 | 3 | Baud Options 4 | 5 | Parity 9600 default ON Mode off 19200 on on off even default 6 | Termination inaktiv default off RTU default on 38400 on **odd** on ASCI on on 57600 off no on 1200hm

To set the dip switches according to the above illustration, the cover of the internal sensor housing has to be removed.

- 1. Remove the cover of the LK-S CO2, by removing the 4 screws on top of the housing and then remove the cover.
- 2. Now use a small screwdriver to unlock the cover of the internal sensor housing see figure below.
- Remove the cover of the internal sensor housing.

### Application notice


Dirt in the air can collect on the filter and then adversely affect the operation of the sensor after a certain time.

Under normal ambient condition an annual maintenance is recommended. Rinse the filter after cleaning with distilled water and dry it using clean oil-free air or nitrogen. Extremely contaminated filters should be replaced.

At extreme ambient conditions, e.g. corrosive gases, the humidity sensor may have to be changed.

Issue date: 24.08.2015 Page 5 / 5

## Dimensions (mm)

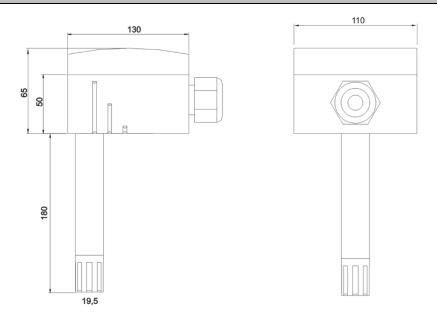

### **Accessories**

Rawl plugs and screws (2 pcs each)

Filter stainless steel, wire mesh

Mounting flange MF20 TPO

Item No. 102209

Item No. 231169

Item No. 612562